


CONTRACTION JOINT (C.J.)
OR LONGITUDINAL JOINT (L.J.)




EXPANSION JOINT (E.J.)




ALT. LONGITUDINAL CONSTRUCTION JOINT




SECTION A1 – A1

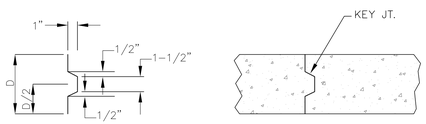


SECTION B1 – B1

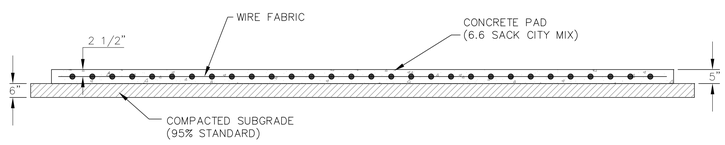


7' X 14' BUS SHELTER PAD

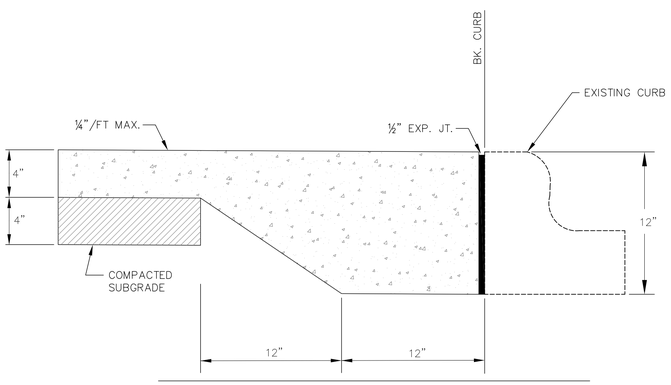


7' X 14' SHELTER LAYOUT

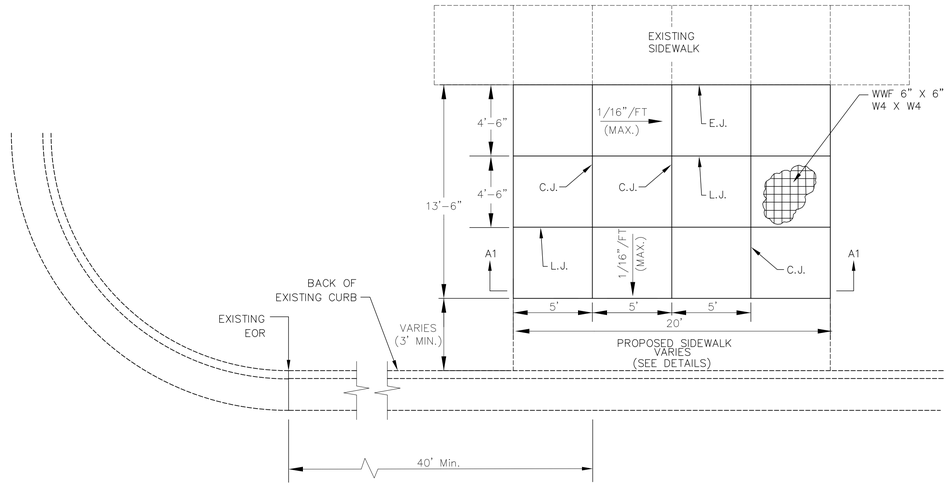


SIDEWALK CONSTRUCTION, D≤5'

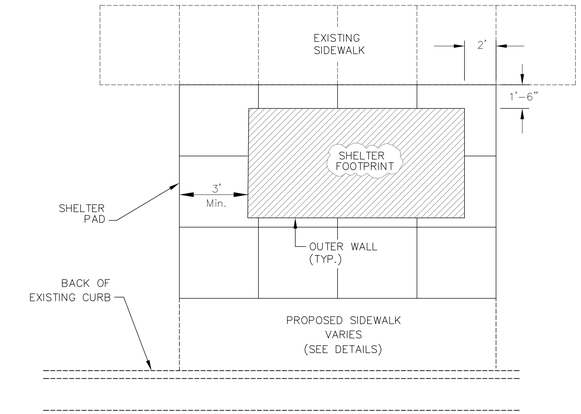


SIDEWALK CONSTRUCTION, D>5'

## GENERAL NOTES

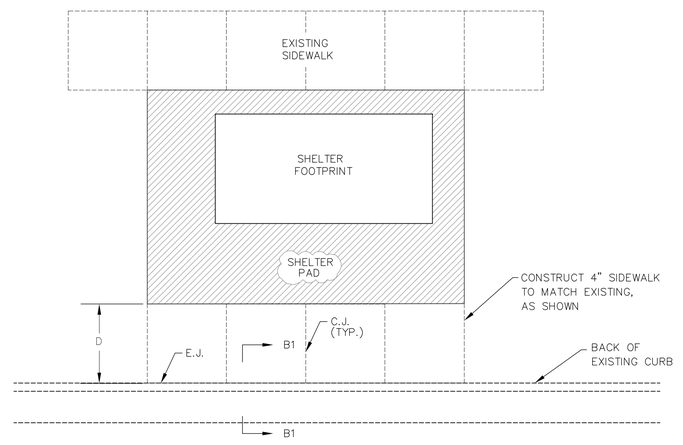1. IN THE ABSENCE OF EXISTING SIDEWALK, THE MINIMUM 5' SET BACK DISTANCE SHALL BE MAINTAINED.
2. EXCEPT AS OTHERWISE NOTED, SIDEWALK SLOPE MUST NOT EXCEED 5% IN THE DIRECTION OF TRAVEL, OR 2% PERPENDICULAR TO THE DIRECTION OF TRAVEL.
3. ALL SIDEWALK WITHIN 5'OF BACK-OF-CURB MUST BE CONSTRUCTED AS A LANDING AREA, WITH SLOPES NOT IN EXCESS OF 2% IN ANY DIRECTION.
4. ALL CONCRETE MUST MEET THE REQUIREMENTS OF THE 6.6 SACK CITY MIX.

AUGUST 2015

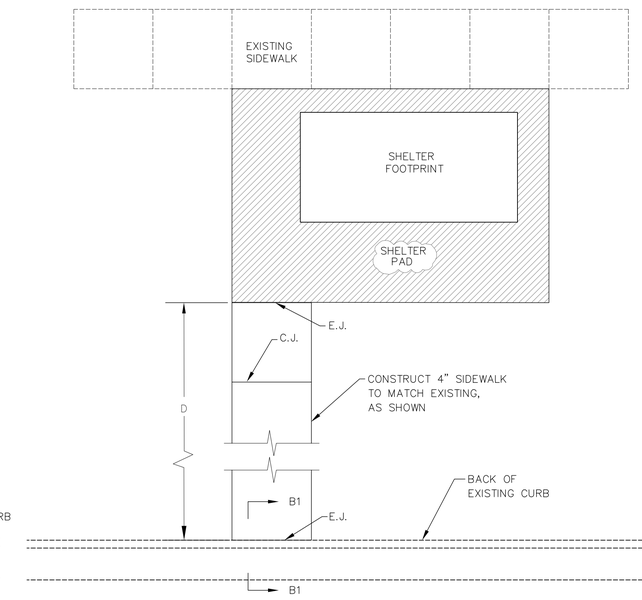CITY OF WICHITA
PUBLIC WORKS & UTILITIES
ENGINEERING DIVISION

7' X 14' SHELTER
STANDARD DETAILS

CITY ENGINEER
GARY JANZEN, P.E.

| PROJECT NUMBER | OCA NUMBER | DATE |
|---|---|---|
| | | |

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET

PV-145