

CONTRACTION JOINT (C.J.)
OR LONGITUDINAL JOINT (L.J.)



EXPANSION JOINT (E.J.)

ALT. LONGITUDINAL CONSTRUCTION JOINT

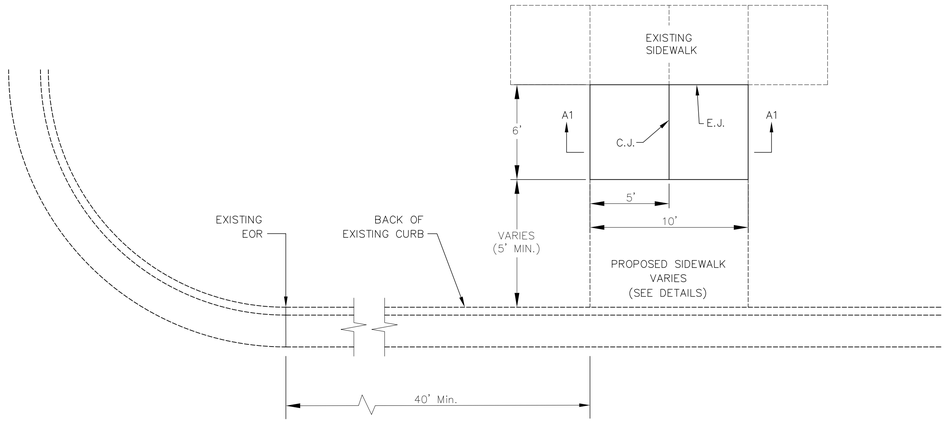

FREESTANDING BENCH PAD

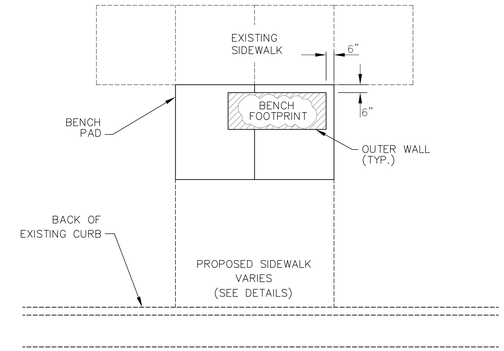

BENCH LAYOUT

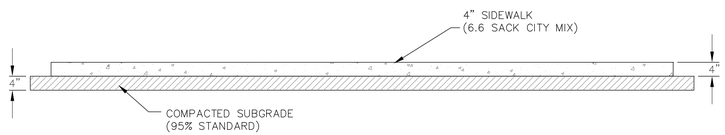

SECTION A1 – A1

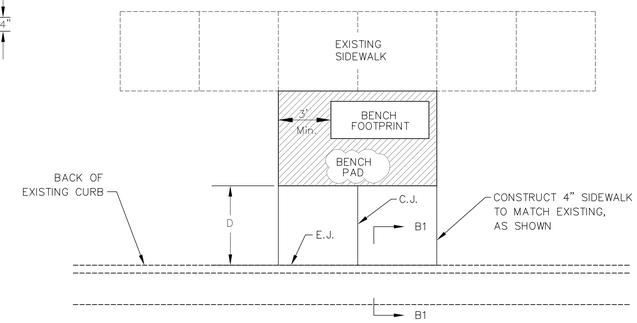

SIDEWALK CONSTRUCTION, D≤5'

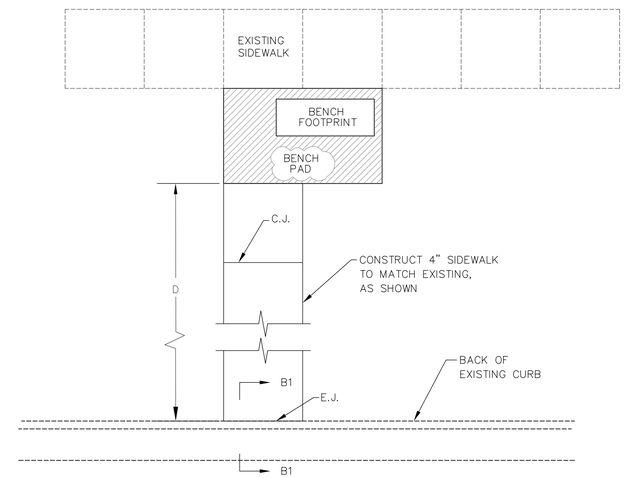

SIDEWALK CONSTRUCTION, D>5'

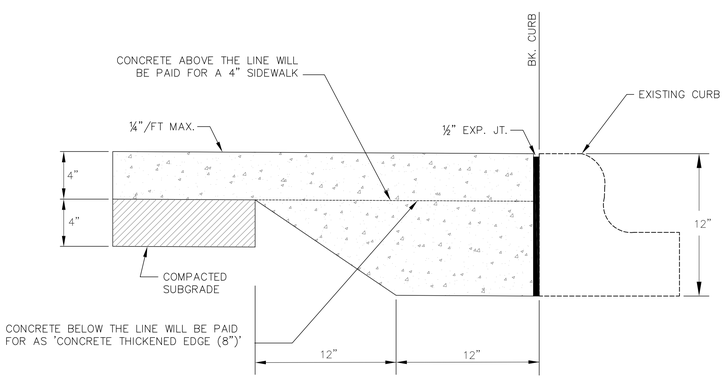

SECTION B1 – B1

GENERAL NOTES

1. IN THE ABSENCE OF EXISTING SIDEWALK, THE MINIMUM 5' SET BACK DISTANCE SHALL BE MAINTAINED.
2. EXCEPT AS OTHERWISE NOTED, SIDEWALK SLOPE MUST NOT EXCEED 5%, IN THE DIRECTION OF TRAVEL, OR 2% PERPENDICULAR TO THE DIRECTION OF TRAVEL.
3. ALL SIDEWALK WITHIN 5'OF BACK-OF-CURB MUST BE CONSTRUCTED AS A LANDING AREA, WITH SLOPES NOT IN EXCESS OF 2% IN ANY DIRECTION.
4. ALL CONCRETE MUST MEET THE REQUIREMENTS OF THE 6.6 SACK CITY MIX.

AUGUST 2015

CITY OF WICHITA
PUBLIC WORKS & UTILITIES
ENGINEERING DIVISION

FREESTANDING BENCH
STANDARD DETAILS

CITY ENGINEER
GARY JANZEN, P.E.

PROJECT NUMBER	OCA NUMBER	DATE

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501

SHEET

PV-143